



IRCCOS S.c.a r.l.

Istituto di Ricerca e certificazione per le Costruzioni Sostenibili

Test Laboratory Notified in accordance with Regulation (EU) No 305/2011

TEST REPORT

Number:

1994-CPR-RP1205

Issuing date:

2015-11-04

Applicant:

ETEM BULGARIA S.A
119A, Ilenci Blvd, Sofia, 1220, Bulgaria

Tested product:

**Hotel type: single vent with Lift & Slide hardware combined
with fixed glazing**

Trade name: "E50"

(cf. description)

Executed tests:

Air permeability

Watertightness

Resistance to wind load

Normative References:


EN 14351-1:2006+A1:2010

EN 1026:2000 EN 12207:1999

EN 1027:2000 EN 12208:1999

EN 12211:2000 EN 12210:1999

Resume of classes assigned on the basis of the results of the tested sample of a Hotel type door: single vent with lift & slide hardware combined with fixed glazing, with trade name “E50”, according to TR n° 1994-CPR-RP1205, issued on 2015-11-04 to ETEM BULGARIA S.A..

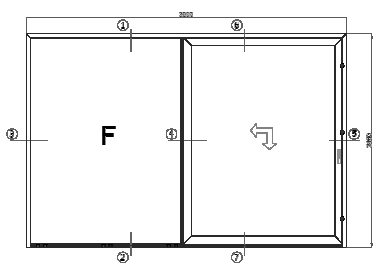
Scheme of the tested sample	Test	Test standard	Classification standard	Obtained Class	Cf. § TR
	Air permeability	EN 1026:2000	EN 12207:1999	class 4	§ 7.2.1
	Watertightness	EN 1027:2000	EN 12208:1999	class 9A	§ 7.3.1
	Resistance to wind load	EN 12211:2000	EN 12210:1999	class C1/B2	§ 7.4.5

Limitations

This Test Report does not represent either an evaluation the suitability of use or a certificate of product conformity. The results obtained refer exclusively to the samples tested.

Technical Operator

Katia Foti
Matteo Mariotto



The chairman

Giovanni Cavanna



-----End of the Test Report No. 1994-CPR-RP1205-----